



**NEMO|etc.**

Certificate of Authorization #32455  
353 Christian Street, Unit #13  
Oxford, CT 06478  
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

**EVALUATION REPORT BY FLORIDA P.E.**

**IB Roof Systems, Inc.**

506 E. Dallas Road, Suite 300  
Grapevine, TX 76051  
(800) 426-1626

**Evaluation Report 02641.03.04-R17**

**FL2534-R17 (NON-HVHZ)**

**Date of Issuance: 07/18/2005**

**Revision 17: 02/10/2023**

**SCOPE:**

This Evaluation Report is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The product described herein has been evaluated for compliance with the **7<sup>th</sup> Edition (2020) Florida Building Code** [sections noted herein](#).

**DESCRIPTION: IB Single Ply Roof Systems for use in FBC non-HVHZ jurisdictions**

**LABELING:** Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein.

**CONTINUED COMPLIANCE:** This Evaluation Report is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our Evaluation Reports by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its Evaluation Report relative to updated Code requirements with each Code Cycle.


**ADVERTISEMENT:** The Florida Product Approval Number (FL#) preceded by the words "Nemo P.E. Evaluated" may be displayed in advertising literature. If any portion of the Evaluation Report is displayed, then it shall be done in its entirety.

**INSPECTION:** Upon request, a copy of this entire Evaluation Report shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This Evaluation Report consists of pages 1 through 4, plus a 56-page Appendix.

Prepared by: **Digitally signed**  
**by Robert**  
**Nieminen**  
**Date: 2023.02.10**  
**'11:30:28 -05'00**

This item has been digitally signed and sealed by Robert Nieminen, P.E.  
Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.  
Robert Nieminen, Florida P.E. 59166, FBC ANE1983  
NEMO ETC, LLC, Florida CA #32455

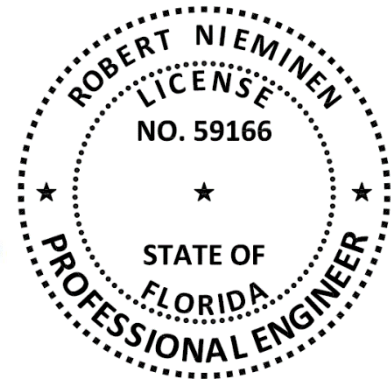

**CERTIFICATION OF INDEPENDENCE:**

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the evaluation reports are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

©2019 NEMO ETC, LLC

**ROOFING SYSTEMS EVALUATION:**
**1. SCOPE:**

**Product Category:** Roofing  
**Sub-Category:** Single Ply Roof Systems  
**Product Approval Method:** Method 1, Option D – Codified Material, Evaluation by Engineer  
**Compliance Statement:** **IB Single-Ply Roof Systems**, as produced by **IB Roof Systems, Inc.**, have demonstrated compliance with the following sections of the **7<sup>th</sup> Edition (2020) Florida Building Code** through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

**2. STANDARDS:**

SECTION	PROPERTY	STANDARD	YEAR
1504.3.1	Wind resistance	FM 4474	2011
1504.6	Accelerated weathering	ASTM G154	2012
1504.7	Impact resistance	FM 4470	2016
1507.13.2	Material standard	ASTM D4434	2012

**3. REFERENCES:**

ENTITY	EXAMINATION	REFERENCE	DATE
ERD (TST6049)	ASTM D4434 / G154	SC9875.10.16	10/27/2016
NEMO (TST6049)	ASTM D4434 / G154	4r-CGT-19-SSTHP-01.A	02/19/2020
NEMO (TST6049)	ASTM D4434 / G154	4r-CGT-19-SSTHP-01.B	02/19/2020
ERD (TST6049)	FM 4470/4474	I11110.11.08-2	12/01/2008
ERD (TST6049)	FM 4470/4474	I11110.02.09	02/05/2009
ERD (TST6049)	TAS 117(A)	SC5790.04.14	04/21/2014
ERD (TST6049)	FM 4470/4474	SC5160.01.15-R1	02/03/2015
ERD (TST6049)	FM 4470	IBR-SC10205.03.16	03/03/2016
ERD (TST6049)	FM 4470/4474	SC10010.02.16-R1	07/06/2016
ERD (TST11294)	FM 4470/4474	CTL12090.12.16	12/08/2016
ERD (TST6049)	FM 4470/4474	SC12085.12.16-1	12/13/2016
ERD (TST6049)	FM 4470/4474	SC12085.12.16-2	12/13/2016
ERD (TST6049)	Criticality	ICP-SC15630.09.17	09/06/2017
ERD (TST6049)	Criticality	ICP-SC16225.09.17	09/06/2017
ERD (TST6049)	FM 4474	IBR-SC13490.17	09/27/2017
ERD (TST11294)	FM 4474	IBR-CTL13490.17	09/29/2017
FM (TST1867)	FM 4470	2D5A9.AM	06/22/1999
FM (TST1867)	FM 4470	3005937	11/23/1999
FM (TST1867)	FM 4470	3005938	11/23/1999
FM (TST1867)	FM 4470	3009502	12/21/2000
FM (TST1867)	FM 4470	3015444	07/11/2003
FM (TST1867)	FM 4470	3014692	08/05/2003
FM (TST1867)	FM 4470	3014751	08/27/2003
FM (TST1867)	FM 4470/4474	3012321	07/29/2006
FM (TST1867)	FM 4470/4474	3022560	07/07/2006
FM (TST1867)	FM 4470/4474	3024973	11/10/2006
FM (TST1867)	FM 4470/4474	3026528	11/21/2006
FM (TST1867)	FM 4470/4474	3029864	09/06/2007
FM (TST1867)	FM 4470/4474	3055491	12/05/2016
FM (TST1867)	FM 4470/4474	3063970	09/14/2018
FM (TST1867)	Criticality	PR456960 LTR	02/09/2021
FM (TST1867)	FM 4474	PR457312	04/20/2021
NEMO (TST6049)	FM 4474	4a-ICP-19-LSWUS-01.A	11/08/2019
NEMO (TST6049)	Criticality	4i-IBR-19-SSCRT-01.A	11/14/2019
NEMO (TST6049)	Criticality	4i-IBR-20-SSCRT-01.A	07/09/2020

ENTITY	EXAMINATION	REFERENCE	DATE
NEMO (TST6049)	FM 4474	4a-IBR-20-LSWUS-01.A	12/15/2020
NEMO (TST6049)	Criticality	4i-IBR-21-SSCRT-01.A	09/27/2021
NEMO	Traceability	FBC Cross-Listing	07/22/2021
NEMO	Data Release	Data Release Agreement	02/03/2023
Supplier / Manufacturer	Quality Control	Declaration	09/15/2016
UL, LLC. (QUA9625)	Quality Control	MLA	10/31/2016
UL, LLC. (QUA9625)	Quality Control	Service Confirmation	12/10/2020
UL, LLC. (QUA9625)	Traceability	ML File No. R15546	07/13/2021
UL, LLC. (QUA9625)	Quality Control	Florida BCIS	Current

#### 4. PRODUCT DESCRIPTION:

This Evaluation Report covers **IB Single Ply Roof Systems** installed in accordance with **IB Roof Systems, Inc** published installation instructions and the [Limitations of Use](#) herein.

TABLE 1: EVALUATED MEMBRANES						
TYPE	PRODUCT		MATERIAL STANDARD			PLANT(s)
			REFERENCE	TYPE	GRADE	
ROOF COVER	IB PVC Single Ply	40, 60 or 80-mil	ASTM D444	III	N/A	Cambridge, Ontario
	IB PVC Single Ply Fleeceback	40, 60 or 80-mil	ASTM D444	III	N/A	
	IB PVC	50, 60 or 80-mil	ASTM D444	III	N/A	Mountain Top, PA
	IB PVC Fleeceback	50, 60 or 80-mil	ASTM D444	III	N/A	

#### 5. LIMITATIONS:

- 5.1 This is a Building Code Evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.
- 5.2 This Evaluation Report is not for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (i.e., Broward and Miami-Dade Counties).
- 5.3 This Evaluation Report pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This Evaluation Report does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.
- 5.5 This Evaluation Report does not include evaluation of roof edge termination. Refer to **FBC 1504.5** for requirements and limitations regarding edge securement for low-slope roofs.
- 5.6 Refer to **FBC 1511** for requirements and limitations regarding recover installations.
- 5.6.1 For mechanically attached components over existing roof decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing shall be in accordance with [ANSI/SPRI FX-1](#) or [Testing Application Standard TAS 105](#).
- 5.6.2 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance with [ANSI/SPRI IA-1](#), [ASTM E907](#), [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#) shall be conducted on mock-ups of the proposed new roof assembly.

- 5.6.3 For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing in accordance with **ASTM E907**, [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#).
- 5.7 Refer to Appendix 1 for system attachment requirements for wind load resistance.
- 5.7.1 “MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied). Refer to **FBC 1609** for determination of design wind loads.
- 5.7.2 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with **FBC Chapter 16**. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI WD1](#), [FM Loss Prevention Data Sheet 1-29](#), [Roofing Application Standard RAS 117](#) and [Roofing Application Standard RAS 137](#). Assemblies marked with an asterisk\* carry the limitations set forth in **Section 2.2.10.1** of [FM Loss Prevention Data Sheet 1-29 \(February 2020\)](#) for Zone 2/3 enhancements.
- 5.7.3 For assemblies with all components fully bonded in place, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with **FBC Chapter 16**. No rational analysis is permitted for these systems.
- 5.8 All components in the roof assembly shall have quality assurance audit in accordance with **F.A.C. Rule 61G20-3**. Refer to the Product Approval of the component manufacturer for components listed in Appendix 1 that are produced by a Product Manufacturer other than the report holder on [Page 1](#) of this Evaluation Report.

## 6. INSTALLATION:

**IB Single Ply Roof Systems** shall be installed in accordance with **IB Roof Systems** published installation instructions, subject to the [Limitations of Use](#) noted herein.

## 7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

## 8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

## 9. QUALITY ASSURANCE ENTITY:

[UL \(QUA9625\)](#): (360) 817-5512; [bsai.inspections@ul.com](mailto:bsai.inspections@ul.com)

**- THE 56-PAGES THAT FOLLOW FORM PART OF THIS EVALUATION REPORT**

**APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE:**

TABLE	DECK	APPLICATION	TYPE	DESCRIPTION	PAGE
<a href="#">1A</a>	Wood	New, Reroof (Tear-Off) or Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	6
<a href="#">1B</a>	Wood	New, Reroof (Tear-Off) or Recover	B-2	Mechanically Attached Thermal Barrier, Bonded Vapor Barrier, Bonded Insulation, Bonded Roof Cover	7
<a href="#">1C</a>	Wood	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	7
<a href="#">1D</a>	Wood	New, Reroof (Tear-Off), Recover	C-2	Induction Welded Roof Cover	8
<a href="#">1E</a>	Wood	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover	9
<a href="#">1F</a>	Wood	New, Reroof (Tear-Off), Recover	E-1	Non-Insulated, Mechanically Attached Roof Cover	10
<a href="#">2A</a>	Steel	New, Reroof (Tear-Off) or Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	11
<a href="#">2B</a>	Steel	New, Reroof (Tear-Off) or Recover	B-2	Mechanically Attached Thermal Barrier, Bonded Vapor Barrier, Bonded Insulation, Bonded Roof Cover	14
<a href="#">2C</a>	Steel	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	15
<a href="#">2D</a>	Steel	New, Reroof (Tear-Off), Recover	C-2	Induction Welded Roof Cover	19
<a href="#">2E</a>	Steel	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover	20
<a href="#">3A</a>	Structural concrete	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	21
<a href="#">3B</a>	Structural concrete	New, Reroof (Tear-Off), Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	34
<a href="#">3C</a>	Structural concrete	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	39
<a href="#">3D</a>	Structural concrete	New, Reroof (Tear-Off), Recover	C-2	Induction Welded Roof Cover	39
<a href="#">3E</a>	Structural concrete	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover	40
<a href="#">3F</a>	Structural concrete	New, Reroof (Tear-Off)	F	Non-Insulated, Bonded Roof Cover	40
<a href="#">4A</a>	Lightweight concrete	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	41
<a href="#">4B</a>	Lightweight concrete	New, Reroof (Tear-Off)	F	Non-Insulated, Bonded Roof Cover	44
<a href="#">5A</a>	Cementitious wood fiber	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	45
<a href="#">6A</a>	Existing gypsum	Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	46
<a href="#">7A</a>	Various	Recover	A-1	Bonded Insulation, Bonded Roof Cover	49
<a href="#">7B</a>	Steel	Recover	C-2	Induction Welded Roof Cover	55
<a href="#">7C</a>	Steel	Recover	D-1	Insulated, Mechanically Attached Roof Cover	55
<a href="#">7D</a>	Various	Recover	F	Non-Insulated, Bonded Roof Cover	56

**The following notes apply to the systems outlined herein:**

- 1 The roof system evaluation herein pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 2 Unless otherwise noted, fasteners and stress plates shall be as follows. Fasteners shall be of sufficient length for the following engagements:

FASTENER/PLATE OPTIONS				
DECK TYPE	By	FBC	PARTS	MINIMUM ENGAGEMENT
Wood	IB Roof	N/A	IB DF12 Standard Fastener or IB DF14 Roofing Fastener with IB 3" Round Metal Insulation Plates or IB Standard Fastener or IB Heavy Duty Fastener with IB Insulation Plates	Minimum ¾-inch plywood penetration or minimum 1-inch wood plank embedment
	OMG, Inc.	FL699	OMG #12 Roofgrip or OMG #14 Roofgrip with OMG 3 in. Galvalume Steel Plates	
	SFS Group USA	FL20311	Dekfast DF-#12-PH3 or Dekfast DF-#14-PH3 with Dekfast PLT-R-3	
Steel	IB Roof	N/A	IB DF12 Standard Fastener, IB DF14 Roofing Fastener or IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or IB Standard Fastener, IB Heavy Duty Fastener or IB Magnum Fastener with IB Insulation Plates	Minimum ¾-inch steel penetration and engage the top flute of the steel deck
	OMG, Inc.	FL699	OMG #12 Roofgrip, OMG #14 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates	
	SFS Group USA	FL20311	Dekfast DF-#12-PH3, Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	
Structural Concrete	IB Roof	N/A	IB DF14 Roofing Fastener with IB 3" Round Metal Insulation Plates or IB Heavy Duty Fastener with IB Insulation Plates	Minimum 1-inch embedment. Fasteners installed with a pilot hole in accordance with the fastener manufacturer's published installation instructions
	OMG, Inc.	FL699	OMG #14 Roofgrip or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	
	SFS Group USA	FL20311	Dekfast DF-#14-PH3 with Dekfast PLT-R-3	

- 3 Unless otherwise noted, insulation may be any one layer or combination of FBC Approved (Local or Statewide) board(s) that meet FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.
- 4 Minimum 200 psi, minimum 2-inch thick FBC Approved lightweight insulating concrete may be substituted for, or installed below, rigid insulation board for System Types B-1, C-1, C-2, D-1 or D-2, whereby fasteners are installed through the lightweight insulating concrete to engage the structural deck. The structural deck shall be of equal or greater type, thickness and strength to the steel and structural concrete deck listings. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. This is a wind uplift resistance allowance and does not purport to address non-wind-uplift-related issues, such as deck venting or moisture levels within the LWIC and the potential effect on overlying components.
- 5 Preliminary insulation attachment: Unless otherwise noted, use FBC Approved roofing fasteners and plates and refer to Section 2.2.10.1.3 of [FM Loss Prevention Data Sheet 1-29](#).
- 6 Unless otherwise noted, insulation adhesive application rates are as follows.  
 Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer's published instructions.  
 If applying hot asphalt to concrete deck, deck shall be primed with ASTM D41 primer.  
 When multiple layers(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, board joints shall be staggered.  
 The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.

INSULATION ADHESIVE REFERENCES				
By	FBC	ADHESIVE	REFERENCE	MINIMUM RATE
IB Roof	N/A	IB Rapid Set Insulation Adhesive	IB-RSIA	Continuous 0.5 to 0.75-inch ribbons, 12-inch o.c.
Dupont de Nemours	FL720	INSTA STIK Quik Set Insulation Adhesive	Insta-Stik	Continuous 0.75 to 1-inch ribbons, 12-inch o.c.
H.B. Fuller Company	FL1800	Millennium One-Step Foamable Adhesive	M-OSFA	Continuous 0.5 to 0.75-inch ribbons, 12-inch o.c. Note: Millennium One Step Green Foamable Adhesive may be used in place of M-OSFA
		Millennium PG-1 Pump Grade Adhesive	M-PG1	Continuous 0.5 to 0.75-inch ribbons, 12-inch o.c. Millennium PG-1 SAF Pump Grade Adhesive may be used in place of M-PG1
		Millennium PG-1 EF ECO	M-PG1-EF-ECO	Continuous 1 to 1.5-inch ribbons, 12-inch o.c.

INSULATION ADHESIVE REFERENCES				
By	FBC	ADHESIVE	REFERENCE	MINIMUM RATE
ICP Construction, Inc.	FL22256	Polyset BOARD-MAX	Polyset BOARD-MAX	Continuous 3-inch ribbons, 12-inch o.c.
	FL1365	Polyset Commercial Roof Adhesive	Polyset CRA	Continuous 2.5 to 3.5-inch ribbons, 12-inch o.c.
OMG, Inc.	FL1608	OlyBond 500 Adhesive Fastener	OB500	Continuous 0.75 to 1-inch wide ribbons, 12-inch o.c. Note: Canister, PaceCart or SpotShot dispensing options.
Generic	ASTM D312, Type IV	hot asphalt	HA	Full coverage at 25-30 lbs/square

- 7 Unless otherwise noted, all insulations are flat-stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to 'increase' the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table.

MDP LIMITATIONS FOR TAPERED POLYISOCYANURATE INSULATIONS				
ADHESIVE	COVERAGE	INSULATION	MIN. TAPERED THICKNESS (IN)	MDP (psf)
IB-RSIA	12-inch o.c.	Listed polyisocyanurate	0.5	-157.5
M-OSFA or M-PG1	12-inch o.c.	Listed polyisocyanurate	0.5	-157.5
Polyset CRA	12-inch o.c.	Listed polyisocyanurate	1.0	-117.5
OB500	12-inch o.c.	Rmax "Multi-Max FA3"	0.5	-45.0
		Johns Manville "ENRGY 3"	0.5	-315.0
		EnergyBoard II or Atlas "ACFoam II"	0.5	-487.5

- 8 For adhered roof insulation and board-size: Unless otherwise noted, refer to Section 2.2.10.6.2 of [FM Loss Prevention Data Sheet](#) 1-29.
- 9 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with FBC Chapter 16. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI](#) WD1, [FM Loss Prevention Data Sheet](#) 1-29, [Roofing Application Standard](#) RAS 117 and [Roofing Application Standard](#) RAS 137. Assemblies marked with an asterisk\* carry the limitations set forth in Section 2.2.10.1 of [FM Loss Prevention Data Sheet](#) 1-29 for Zone 2/3 enhancements.
- 10 For assemblies with all components fully bonded, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16. No rational analysis is permitted for these systems.
- 11 For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing and analysis shall be in accordance with [ANSI/SPRI](#) FX-1 or [Testing Application Standard](#) TAS 105.
- 12 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing shall be conducted on mock-ups of the proposed new roof assembly. For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing. Field uplift testing shall be in accordance with ASTM E907, [FM Loss Prevention Data Sheet](#) 1-52 or [Testing Application Standard](#) TAS 124.
- 13 Refer to FBC 1511 for requirements and limitations regarding recover installations. For Structural Concrete Deck or Recover Applications using System Type C-1 the base insulation layer is optional and for System Type C-2, D-1 or D-2, the insulation is optional. Alternatively, an FBC Approved insulation board or coverboard may be used as a separation layer. Board products shall be preliminarily attached prior to roof cover installation ([Note 5](#)). The separator component shall be documented as meeting FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover in Recover applications.

- 14 Lightweight insulating concrete (LWIC) shall be cast in accordance with FBC Section 1917 to the satisfaction of the Authority Having Jurisdiction. For systems where specific LWIC is referenced, refer to current LWIC Product Approval for specific deck construction and limitations. Unless otherwise noted, for systems where specific LWIC is not referenced, the minimum design mix shall be 300 psi. In all cases, the minimum top-coat thickness is 2-inches. For LWIC over structural concrete, reference is made to FBC Section 1917.4.1, Point 1. For “pre-existent” LWIC references, listings were established through testing over lightweight concrete cast using only foaming agent (ASTM C896), water and Portland cement (ASTM C150), with no proprietary additives, in accordance with procedures adopted by Miami-Dade BCCO (FBC CER1592). Use of these listings in new construction or re-roof (tear-off) applications is at the discretion of the Designer or Record and Authority Having Jurisdiction.

- 15 For bonded membrane applications, unless otherwise noted, refer to the following.

MEMBRANE / ADHESIVE COMBINATIONS				
MEMBRANE	ADHESIVE		APPLICATION	RATE
	TRADE NAME	REFERENCE		
“IB PVC” or “IB PVC Single Ply”	IB Water Borne Adhesive	IB-WBA	Wet lay (substrate)	1 gal per 125 - 175 square feet
“IB PVC” or “IB PVC Single Ply”	IB Water Borne 636 Adhesive	IB-WBA-636	Wet lay (substrate)	1 gal per 140 - 180 square feet
“IB PVC” or “IB PVC Single Ply”	IB Vertibond PVC Bonding Adhesive	IB-Vertibond	Contact (both sides)	1 gal per 50 - 70 square feet, finish
“IB PVC” or “IB PVC Single Ply”	IB Vertibond 432 Bonding Adhesive	IB-Vertibond-432	Contact (both sides)	1 gal per 60 square feet, finish
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	IB Water Borne Adhesive	IB-WBA	Wet lay (substrate)	1 gal per 100 - 160 square feet
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	IB Water Borne 636 Adhesive	IB-WBA-636	Wet lay (substrate)	1 gal per 100 - 120 square feet
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	IB Vertibond PVC Bonding Adhesive	IB-Vertibond	Contact (both sides)	1 gal per 45 - 60 square feet, finish
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	IB Vertibond 432 Bonding Adhesive	IB-Vertibond-432	Contact (both sides)	1 gal per 60 square feet, finish
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	ICP Adhesives Polyset CRA	Polyset CRA-SPATTER	Wet lay (substrate)	“Spatter pattern” at 3.75 lbs/sq.
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	HB Fuller Millennium PG-1 Pump Grade Adhesive	M-PG1	Wet lay (substrate)	Continuous ribbons spaced as noted in tables herein.
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	HB Fuller Millennium PG-1 Pump Grade Adhesive	M-PG1-LPS	Wet lay (substrate)	Low-Pressure Spray at 1,300 to 1,800 square feet per 5 gallon kit (0.55 to 0.75 gal/square)
“IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback”	HB Fuller Millennium PG-1 EF ECO	M-PG1-EF-ECO	Wet lay (substrate)	“Spatter pattern” at 0.3 gal/square.

- 15A For single-ply membranes in System Type D-1 steel deck applications, the roof membrane shall be run with its length perpendicular to the steel deck flutes. For membrane attachment using batten-strips, batten-strip end laps shall be spliced with sufficient dimension to allow for minimum 2-fasteners at each batten-strip lap.

- 15B For System Type C-2 (induction weld), care shall be taken to ensure that the plates do not line-up with membrane seams. This condition may preclude proper induction welding of the membrane to the plates

- 16 Vapor barrier options for use over structural concrete deck followed by bonded insulation carry the following MDP limitations. The lesser of the MDP listings below vs. that of the selected assembly applies.

VAPOR BARRIER OPTIONS; STRUCTURAL CONCRETE DECK; FOLLOWED BY ADHESIVE-APPLIED INSULATION					
OPTION #	PRIMER	VAPOR BARRIER		INSULATION ADHESIVE PER <a href="#">TABLE 3A</a>	MDP (psf)
		TYPE	APPLICATION		
C-VB-1.	IBarrier Primer or IBarrier Primer LV	IBarrier	Self-adhering	IB-RSIA, M-OSFA or M-PG1, 12-inch o.c.	-495.0
C-VB-2.	ASTM D41	One or two plies, FBC Approved ASTM D4601, Type II base sheet and/or ASTM D2178, Type IV or VI ply sheet	Hot asphalt	IB-RSIA, M-OSFA or M-PG1, 12-inch o.c.	-495.0
C-VB-3.	ASTM D41	Holcim "Elevate SBS Glass FR Torch" or "Elevate SBS Poly Torch Base"	Torch-applied	IB-RSIA, M-OSFA or M-PG1, 12-inch o.c.	-495.0
C-VB-4.	ASTM D41	CertainTeed "Flintlastic GTA", Holcim "Elevate APP 180 FR", GAF "Ruberoid Torch Granule", Johns Manville "APPeX 4.5M", SOPREMA "ELASTOPHENE Flam GR" or "SOPRALENE Flam 180 FR GR" or "SOPRALENE Flam 250 FR GR" or Siplast "Paradiene 30 TG"	Torch-applied	Polyset CRA, 12-inch o.c.	-169.0
C-VB-5.	ASTM D41	CertainTeed "Flintlastic SA Cap", GAF "Liberty SBS Self-Adhering Cap Sheet", Polyglass "Elastoflex SA P" or SOPREMA "ELASTOPHENE Stick FR GR"	Self-adhering	Polyset CRA, 12-inch o.c.	-250.0
C-VB-6.	ASTM D41	One or two plies, FBC Approved ASTM D4601, Type II base sheet and/or ASTM D2178, Type IV or VI ply sheet	Hot asphalt	Polyset CRA, 12-inch o.c.	-262.5
C-VB-7.	ASTM D41	CertainTeed "Flintlastic GMS", Holcim "Elevate SBS Cap", GAF "Ruberoid 30 Granule", Johns Manville "DynaGlas", SOPREMA "ELASTOPHENE LS FR GR" or "SOPRALENE 180 FR GR" or "SOPRALENE 250 FR GR" or Siplast "Paradiene 30"	Hot asphalt	Polyset CRA, 12-inch o.c.	-270.0
C-VB-8.	IBarrier Primer or IBarrier Primer LV	IBarrier	Self-adhering	OB500, 12-inch o.c.	-307.5

- 17 "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind loads ([Note 9](#) and [Note 10](#)).

**TABLE 1A: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck <a href="#">(Note 1)</a>	Base Insulation Layer			Top Insulation Layer		Roof Cover <a href="#">(Note 15)</a>	MDP <a href="#">(psf)</a>
		Type	Fasten <a href="#">(Note 11)</a>	Attach	Type	Attach <a href="#">(Notes 6,7,8)</a>		
W-1.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO or OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0
W-2.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO or OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0
W-3.	Min. 19/32-inch, APA rated CDX plywood at max. 24-inch spans	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG	IB XHD #15 Roofing Fastener with IB Insulation Plates, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-75.0
W-4.	Min. 19/32-inch, APA rated CDX plywood at max. 24-inch spans	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG	IB XHD #15 Roofing Fastener with IB Insulation Plates, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-75.0
W-5.	Min. 19/32-inch, APA rated CDX plywood at max. 24-inch spans	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG	IB XHD #15 Roofing Fastener with IB Insulation Plates, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, ribbons 6-inch o.c.	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-75.0

**TABLE 1b: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)**
**SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Thermal Barrier			Primer	Vapor Barrier / Temp Roof	Insulation Layer(s)		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf)
		Type	Fasten ( <a href="#">Note 11</a> )	Attach			Type	Attach ( <a href="#">Notes 6,7,8</a> )		
W-6.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft <sup>2</sup>	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACfoam II, ACfoam III, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1 or OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0*
W-7.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft <sup>2</sup>	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACfoam II, ACfoam III, H-Shield or H-Shield CG followed by min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1 or OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0*
W-8.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft <sup>2</sup>	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1.5-inch InsulFoam HD Composite	IB-RSIA, M-OSFA, M-PG1 or OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-45.0*

**TABLE 1c: WOOD DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF) OR RECOVER**
**SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation ( <a href="#">Note 3</a> , <a href="#">Note 13</a> )	Top Insulation Layer			Roof Cover ( <a href="#">Note 15</a> )	MDP (psf)
			Type	Fasteners ( <a href="#">Note 11</a> )	Attach		
W-9.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACfoam II, ACfoam III, H-Shield, H-Shield CG or InsulFoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft <sup>2</sup>	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-45.0
W-10.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACfoam II, ACfoam III or H-Shield, H-Shield CG or min. 0.25-inch DensDeck Prime	Note 2	1 per 1.6 ft <sup>2</sup>	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS	-45.0
W-11.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACfoam II, ACfoam III or H-Shield, H-Shield CG or min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft <sup>2</sup>	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0

**TABLE 1c: WOOD DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF) OR RECOVER  
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation ( <a href="#">Note 3</a> , <a href="#">Note 13</a> )	Top Insulation Layer			Roof Cover ( <a href="#">Note 15</a> )	MDP (psf)
			Type	Fasteners ( <a href="#">Note 11</a> )	Attach		
W-12.	Min. 19/32-inch, APA rated CDX plywood at max. 24-inch spans	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Insulfoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB XHD #15 Roofing Fastener with IB Insulation Plates, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-75.0
W-13.	Min. 19/32-inch, APA rated CDX plywood at max. 24-inch spans	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III or H-Shield, H-Shield CG or min. 0.25-inch DensDeck Prime	IB XHD #15 Roofing Fastener with IB Insulation Plates, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS	-75.0
W-14.	Min. 19/32-inch, APA rated CDX plywood at max. 24-inch spans	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III or H-Shield, H-Shield CG or min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB XHD #15 Roofing Fastener with IB Insulation Plates, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-75.0

**TABLE 1d: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER  
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Insulation Layer ( <a href="#">Note 3</a> , <a href="#">Note 13</a> )	Attachment		Roof Cover ( <a href="#">Note 15B</a> )	MDP (psf)
			Fasteners ( <a href="#">Note 11</a> )	Density		
W-15.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 4.0 ft <sup>2</sup> (2x2 ft grid)	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
W-16.	Min. 7/16-inch OSB or min. 15/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) installed through to engage wood structural members, minimum 1-1/16 inch embedment. ( <i>Field W/D ≥ 540 lbf</i> )	Fasteners spaced max. 12-inch o.c. in rows spaced max. 48-inch o.c. <u>along wood structural members</u>	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-67.5
W-17.	Min. 7/16-inch OSB or min. 15/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) installed through to engage wood structural members, minimum 1-5/16 inch embedment. ( <i>Field W/D ≥ 585 lbf</i> )	Fasteners spaced max. 9-inch o.c. in rows spaced max. 48-inch o.c. <u>along wood structural members</u>	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-97.5

**TABLE 1E: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck <a href="#">(Note 1)</a>	Thermal Barrier	Insulation <a href="#">(Note 3, Note 13)</a>		Roof Cover			<a href="#">MDP (psf)</a>
			Type	Attach <a href="#">(Note 5)</a>	Membrane	Fasteners <a href="#">(Note 11)</a>	Attach	
W-18.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 12-inch x 67-inch	-30.0
W-19.	Min. 15/32-inch, APA rated CDX, 5-ply plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB #12 or IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or Dekfast DF-#12-PH3 or DF-#14-PH3 with Dekfast PLT-R-2-4B plates	In-Seam: 6-inch x 67-inch	-37.5
W-20.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 6-inch x 67-inch	-45.0
W-21.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 4-inch x 67-inch	-52.5
W-22.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 3-inch x 67-inch	-60.0
W-23.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 67-inch	-67.5
W-24.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 31-inch	-127.5

**TABLE 1F: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER  
SYSTEM TYPE E-1: NON-INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck <a href="#">(Note 1)</a>	Thermal Barrier		Roof Cover			<a href="#">MDP (psf)</a>
		Type	Attach	Membrane	Fasteners <a href="#">(Note 11)</a>	Attachment	
W-25.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	Loose laid	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 12-inch x 67-inch	-30.0
W-26.	Min. 15/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	Loose laid	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or Dekfast DF-#12-PH3 or DF-#14-PH3 with Dekfast PLT-R-2-4B plates	In-Seam: 6-inch x 67-inch	-37.5
W-27.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	Loose laid	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 6-inch x 67-inch	-45.0
W-28.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	Loose laid	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 4-inch x 67-inch	-52.5
W-29.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	Loose laid	"IB PVC" or "IB PVC Single Ply"	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG HD Fasteners with OMG 2-in. Barbed Plates	In-Seam: 3-inch x 67-inch	-60.0
W-30.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	Loose laid	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 67-inch	-67.5
W-31.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) Any thermal barrier to obtain fire classification	Loose laid	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 31-inch	-127.5

**TABLE 2A: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation Layer			Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )		MDP (psf)
		Type	Fasten ( <a href="#">Note 11</a> )	Attach	Type	Attach ( <a href="#">Notes 6,7,8</a> )	Base Ply	Cap Ply	
S-1.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, M- PG1-EF-ECO, OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB- Vertibond, IB-Vertibond-432, IB- WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0*
S-2.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, M- PG1-EF-ECO, OB500	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- EF-ECO	-45.0*
S-3.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, M- PG1-EF-ECO, OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied  ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- LPS  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-45.0*
S-4.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, M- PG1-EF-ECO, OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB- Vertibond, IB-Vertibond-432, IB- WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0*
S-5.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, M- PG1-EF-ECO, OB500	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- EF-ECO	-45.0*

**TABLE 2A: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation Layer			Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )		MDP (psf)
		Type	Fasten ( <a href="#">Note 11</a> )	Attach	Type	Attach ( <a href="#">Notes 6,7,8</a> )	Base Ply	Cap Ply	
S-6.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, M- PG1-EF-ECO, OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied  ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- LPS  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-45.0*
S-7.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB- Vertibond, IB-Vertibond-432, IB- WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-60.0
S-8.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied  ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- LPS  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-60.0
S-9.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB- Vertibond, IB-Vertibond-432, IB- WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA- SPATTER	-75.0
S-10.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M- OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied  ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- LPS  ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-75.0

**TABLE 2A: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation Layer			Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )		MDP (psf)
		Type	Fasten ( <a href="#">Note 11</a> )	Attach	Type	Attach ( <a href="#">Notes 6,7,8</a> )	Base Ply	Cap Ply	
S-11.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- EF-ECO	-90.0
S-12.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB- Vertibond, IB-WBA, M-PG1-LPS or Polyset CRA-SPATTER	-97.5
S-13.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-97.5
S-14.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD- MAX, ribbons 6- inch o.c.	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- EF-ECO	-90.0
S-15.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD- MAX, ribbons 6- inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB- Vertibond, IB-WBA, M-PG1-LPS or Polyset CRA-SPATTER	-97.5

**TABLE 2A: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-16.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD- MAX, ribbons 6- inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1- LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-97.5
S-17.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III or H-Shield	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip or #15 Roofgrip with OMG 3 in. Galvalume Steel Plates, IB DF14 or DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or DF-#14-PH3 or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.0 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime	Polyset BOARD- MAX	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB- Vertibond, IB-WBA, Polyset CRA- SPATTER	-105.0

**TABLE 2B: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)**  
**SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor Barrier / Temp Roof	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach			Type	Attach (Notes 6,7,8)		
S-18.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft <sup>2</sup>	IBBarrier Primer or IBBarrier Primer LV	IBBarrier, self- adhered	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M- OSFA, M- PG1 or OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB- Vertibond, IB-Vertibond-432, IB-WBA, IB- WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond- 432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0*
S-19.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft <sup>2</sup>	IBBarrier Primer or IBBarrier Primer LV	IBBarrier, self- adhered	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG followed by min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M- OSFA, M- PG1 or OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0*

**TABLE 2b: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)**
**SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Thermal Barrier			Primer	Vapor Barrier / Temp Roof	Insulation Layer(s)		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf)
		Type	Fasten ( <a href="#">Note 11</a> )	Attach			Type	Attach ( <a href="#">Notes 6,7,8</a> )		
S-20.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft <sup>2</sup>	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1.5-inch InsulFoam HD Composite	IB-RSIA, M-OSFA, M-PG1 or OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-45.0*

**TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER  
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation ( <a href="#">Note 3</a> , <a href="#">Note 13</a> )	Top Insulation Layer			Roof Cover ( <a href="#">Note 15</a> )		MDP (psf)
			Type	Fasteners ( <a href="#">Note 11</a> )	Attach	Base Ply	Cap Ply	
S-21.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min 1.5 in. thick, max. 4 x 4 ft IB EnergyBoard II, ACFoam II or Multi-Max FA3	Note 2	1 per 3.2 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-30.0*
S-22.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min 2 in. thick, max. 4 x 4 ft IB EnergyBoard II, ACFoam II or Multi-Max FA3	Note 2	1 per 4.0 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-45.0*
S-23.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0*
S-24.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft <sup>2</sup>	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0*

**TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach	Base Ply	Cap Ply	
S-25.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft <sup>2</sup>	<ul style="list-style-type: none"> <li>✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied</li> <li>✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"</li> </ul>	<ul style="list-style-type: none"> <li>✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS</li> <li>✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER</li> </ul>	-45.0*
S-26.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	Note 2	1 per 2.0 ft <sup>2</sup>	✓ None	<ul style="list-style-type: none"> <li>✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636</li> <li>✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER</li> </ul>	-45.0*
S-27.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch InsulFoam HD Composite	Note 2	1 per 2.7 ft <sup>2</sup>	✓ None	<ul style="list-style-type: none"> <li>✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636</li> <li>✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER</li> </ul>	-45.0*
S-28.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG or InsulFoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft <sup>2</sup>	✓ None	<ul style="list-style-type: none"> <li>✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636</li> <li>✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER</li> </ul>	-45.0
S-29.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch DensDeck Prime	Note 2	1 per 1.6 ft <sup>2</sup>	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS	-45.0
S-30.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft <sup>2</sup>	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0

**TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach	Base Ply	Cap Ply	
S-31.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB DF12 Standard Fastener, IB DF14 Roofing Fastener or IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates, Dekfast DF-#12- PH3, Dekfast DF-#14-PH3 or Dekfast DF-#15- PH3 with Dekfast PLT-R-3, IB Standard Fastener, IB Heavy Duty Fastener or IB Magnum Fastener with IB Insulation Plates, OMG #12 Roofgrip, OMG #14 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates	1 per 2.0 ft <sup>2</sup>	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch- applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-52.5
S-32.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum- Fiber Roof Board	IB XHD #15 Roofing Fastener with IB Insulation Plates, OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 2.0 ft <sup>2</sup>	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch- applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-60.0
S-33.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	IB DF14 Roofing Fastener or IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates, Dekfast DF-#14-PH3 or Dekfast DF-#15- PH3 with Dekfast PLT-R-3, IB Heavy Duty Fastener or IB Magnum Fastener with IB Insulation Plates, OMG #14 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates	1 per 1.8 ft <sup>2</sup>	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch- applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-67.5
S-34.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum- Fiber Roof Board	IB DF12 Standard Fastener, IB DF14 Roofing Fastener or IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates, Dekfast DF-#12- PH3, Dekfast DF-#14-PH3 or Dekfast DF-#15- PH3 with Dekfast PLT-R-3, IB Standard Fastener, IB Heavy Duty Fastener or IB Magnum Fastener with IB Insulation Plates, OMG #12 Roofgrip, OMG #14 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates	1 per 1.6 ft <sup>2</sup>	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch- applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-67.5
S-35.	Min. 22 ga., Type B, Grade 40 steel	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACfoam II, ACfoam III, H-Shield, H-Shield CG, Insulfoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF- #15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB- Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB- Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-75.0

**TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation ( <a href="#">Note 3</a> , <a href="#">Note 13</a> )	Top Insulation Layer			Roof Cover ( <a href="#">Note 15</a> )		MDP (psf)
			Type	Fasteners ( <a href="#">Note 11</a> )	Attach	Base Ply	Cap Ply	
S-36.	Min. 22 ga., Type B, Grade 40 steel	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch DensDeck Prime	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS	-75.0
S-37.	Min. 22 ga., Type B, Grade 40 steel	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-75.0
S-38.	Min. 22 ga., Type B, Grade 40 steel	(Optional) One or more layers, any combination, min. 1.5-inch loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB Heavy Duty Fastener or IB XHD #15 Roofing Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, #15 Roofgrip or OMG XHD with OMG 3 in. Galvalume Steel Plates, IB DF15 Roofing Fastener with IB 3" Round Metal Insulation Plates or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 1.3 ft <sup>2</sup>	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-75.0
S-39.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board (max. 4x4 ft)	Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 1.0 ft <sup>2</sup> (16 per 4x4 ft board)	US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-157.5

**TABLE 2d: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Insulation Layer ( <a href="#">Note 3</a> , <a href="#">Note 13</a> )	Attachment		Roof Cover ( <a href="#">Note 15B</a> )	MDP ( <a href="#">psf</a> )
			Fasteners ( <a href="#">Note 11</a> )	Density		
S-40.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 6 ft <sup>2</sup> 2x3-ft grid, staggered	"IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-37.5
S-41.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 6 ft <sup>2</sup> 2x3-ft grid, staggered	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-37.5
S-42.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	12-inch o.c. in rows 60-inch o.c.	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
S-43.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	12-inch o.c. in rows 60-inch o.c.	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
S-44.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 6 ft <sup>2</sup> 2x3-ft grid, staggered	"IB PVC" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
S-45.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 4.0 ft <sup>2</sup> 2x2-ft grid, staggered	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
S-46.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 4.0 ft <sup>2</sup> 2x2-ft grid, staggered	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
S-47.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 3.0 ft <sup>2</sup> 1.5 x 2-ft grid, staggered	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-82.5
S-48.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 3.0 ft <sup>2</sup> 1.5 x 2-ft grid, staggered	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-82.5
S-49.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	6-inch o.c. in rows 60-inch o.c.	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0
S-50.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	6-inch o.c. in rows 60-inch o.c.	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0

**TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Thermal Barrier and/or Insulation ( <a href="#">Note 3</a> , <a href="#">Note 13</a> )		Roof Cover ( <a href="#">Note 15A</a> )			MDP (psf)
		Type	Attach ( <a href="#">Note 5</a> )	Membrane	Fasteners ( <a href="#">Note 11</a> )	Attach	
S-51.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 18-inch x 67-inch	-30.0
S-52.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 12-inch x 67-inch	-45.0
S-53.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 67-inch	-67.5
S-54.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	"IB PVC Single Ply"	OMG XHD Fasteners through OMG Polymer Batten Strips	In-Field: 6-inch x 96-inch	-67.5
S-55.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	"IB PVC Single Ply"	OMG XHD Fasteners through OMG Metal Batten Strips	In-Field: 6-inch x 96-inch	-75.0
S-56.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or OMG Metal Batten Strips or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 31-inch	-127.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply		
INSULATION IN HOT ASPHALT:									
C-1.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insulfoam IX	HA (back-mopped)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA (back-mopped)	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-202.5	
C-2.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insulfoam IX	HA (back-mopped)	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	HA (back-mopped)	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-202.5	
C-3.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	HA	(Optional) Additional layers(s) of base insulation	HA	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0	
C-4.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	HA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-255.0	
C-5.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	HA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	HA	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-255.0	
INSULATION IN INSTA-STIK:									
C-6.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	Insta-Stik	(Optional) Additional layers(s) of base insulation	Insta-Stik	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-67.5	

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-7.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	Insta-Stik	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-67.5
C-8.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	Insta-Stik	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-67.5
C-9.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II	Insta-Stik	(Optional) Additional layer(s) of base insulation	Insta-Stik	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-120.0
C-10.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II	Insta-Stik	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-120.0
C-11.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II	Insta-Stik	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-120.0
C-12.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Insta-Stik	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-120.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-13.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Insta-Stik	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-120.0
<b>INSULATION IN IB RAPID SET INSULATION ADHESIVE, MILLENNIUM ONE STEP FOAMABLE ADHESIVE OR MILLENNIUM PG-1 PUMP GRADE ADHESIVE:</b>								
C-14.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, H-Shield or H-Shield CG	IB-RSIA, M-OSFA, M-PG1	Min. 1.5-inch InsulFoam HD Composite	IB-RSIA, M-OSFA, M-PG1	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-102.5
C-15.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	(Optional) Additional layer(s) of base insulation	IB-RSIA, M-OSFA, M-PG1	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
C-16.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-232.5
C-17.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-232.5
C-18.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-232.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-19.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime	IB-RSIA, M-OSFA, M-PG1	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-257.5
C-20.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime	IB-RSIA, M-OSFA, M-PG1	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-257.5
C-21.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-267.5
C-22.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-267.5
C-23.	Min. 2,500 psi structural concrete	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	IB-RSIA, M-OSFA, M-PG1	(Optional) Additional layer(s) of base insulation	IB-RSIA, M-OSFA, M-PG1	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-327.5
C-24.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	IB-RSIA, M-OSFA, M-PG1, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-490.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-25.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-657.5
<b>INSULATION IN MILLENNIUM PG-1 EF ECO ADHESIVE:</b>								
C-26.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	M-PG1-EF-ECO	(Optional) Additional layer(s) of base insulation	M-PG1-EF-ECO	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
C-27.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-232.5
C-28.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-232.5
C-29.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-232.5
C-30.	Min. 2,500 psi structural concrete	Min. 1.5-inch IB EnergyBoard II, ACFoam II, H-Shield or H-Shield CG	M-PG1-EF-ECO	(Optional) Additional layer(s) of base insulation	M-PG1-EF-ECO	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-247.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-31.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime	M-PG1-EF-ECO	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-247.5
C-32.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime	M-PG1-EF-ECO	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-247.5
C-33.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch IB EnergyBoard II, AC Foam II, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-247.5
C-34.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch IB EnergyBoard II, AC Foam II, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-267.5
C-35.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch IB EnergyBoard III or AC Foam III	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-267.5
C-36.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch IB EnergyBoard III or AC Foam III	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-267.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-37.	Min. 2,500 psi structural concrete	Min. 1.5-inch IB EnergyBoard III or AC Foam III	M-PG1-EF-ECO	(Optional) Additional layer(s) of base insulation	M-PG1-EF-ECO	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-327.5
<b>INSULATION IN OLYBOND 500:</b>								
C-38.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-52.5
C-39.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-52.5
C-40.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-52.5
C-41.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, H-Shield or H-Shield CG	OB500	Min. 1.5-inch InsulFoam HD Composite	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-102.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-42.	Min. 2,500 psi structural concrete	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-120.0
C-43.	Min. 2,500 psi structural concrete	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-120.0
C-44.	Min. 2,500 psi structural concrete	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-120.0
C-45.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II	OB500	(Optional) Additional layers(s) of base insulation	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-150.0
C-46.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-150.0
C-47.	Min. 2,500 psi structural concrete	Min. 1.5-inch EnergyBoard II, ACFoam II	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-150.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-48.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	OB500	Min. 0.25-inch DensDeck Prime	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-257.5
C-49.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-267.5
C-50.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	OB500	Min. 0.25-inch DensDeck Prime	OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-282.5
C-51.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	OB500	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-322.5
C-52.	Min. 2,500 psi structural concrete	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	OB500	(Optional) Additional layer(s) of base insulation	OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-327.5
C-53.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	OB500, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-490.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-54.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-657.5
<b>INSULATION IN ICP ADHESIVES POLYSET CRA:</b>								
C-55.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-180.0
C-56.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-180.0
C-57.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-180.0
C-58.	Min. 2,500 psi structural concrete	Min. 1-inch IB Multi-Max FA3, UltraMax	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-250.0
C-59.	Min. 2,500 psi structural concrete	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-272.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-60.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime	Polyset CRA	✓ None	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636	-257.5
C-61.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ None	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636	-267.5
C-62.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS or Polyset CRA-SPATTER	-272.5
C-63.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-272.5
C-64.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, H-Shield or H-Shield CG	Polyset CRA	Min. 0.25-inch DensDeck Prime	Polyset CRA	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-282.5
C-65.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, H-Shield or H-Shield CG	Polyset CRA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-322.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-66.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	Polyset CRA, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-490.0
C-67.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-657.5
<b>INSULATION IN ICP ADHESIVES POLYSET BOARD-MAX:</b>								
C-68.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-180.0
C-69.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-180.0
C-70.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-180.0
C-71.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.5-inch DensDeck Prime	Polyset BOARD-MAX	✓ None	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-232.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-72.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.5-inch DensDeck Prime	Polyset BOARD-MAX	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-232.5
C-73.	Min. 2,500 psi structural concrete	Min. 1-inch IB Multi-Max FA3, UltraMax	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-250.0
C-74.	Min. 2,500 psi structural concrete	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-272.5
C-75.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ None	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636	-267.5
C-76.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-272.5
C-77.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-272.5
C-78.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	Polyset BOARD-MAX, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-490.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

SEE NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-79.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	None	N/A	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-657.5

**TABLE 3B: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-80.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0*
C-81.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0*
C-82.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied"	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-45.0*

**TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation Layer			Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )		MDP (psf)
		Type	Fasten ( <a href="#">Note 11</a> )	Attach	Type	Attach ( <a href="#">Notes 6,7,8</a> )	Base Ply	Cap Ply	
C-83.	Min. 2,500 psi structural concrete	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0*
C-84.	Min. 2,500 psi structural concrete	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0*
C-85.	Min. 2,500 psi structural concrete	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-45.0*
C-86.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-60.0
C-87.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-60.0

**TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Base Insulation Layer			Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )		MDP (psf)
		Type	Fasten ( <a href="#">Note 11</a> )	Attach	Type	Attach ( <a href="#">Notes 6,7,8</a> )	Base Ply	Cap Ply	
C-88.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-75.0
C-89.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	IB-RSIA, Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-75.0
C-90.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-90.0
C-91.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-WBA, M-PG1-LPS or Polyset CRA-SPATTER	-97.5
C-92.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, Polyset CRA, M-OSFA, M-PG1, OB500, ribbons 6-inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-97.5

**TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-93.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, ribbons 6-inch o.c.	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-90.0
C-94.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, ribbons 6-inch o.c.	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-WBA, M-PG1-LPS or Polyset CRA-SPATTER	-97.5
C-95.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, ribbons 6-inch o.c.	✓ Polyglass "Elastoflex S6" or "Elastoflex V", torch-applied ✓ US Ply "DuraFlex 60TG SBS Base" or "DuraFlex 90TG SBS Base, torch-applied	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / Polyset CRA-SPATTER	-97.5
C-96.	Min. 2,500 psi structural concrete	Min. 2-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III or H-Shield	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.0 ft <sup>2</sup>	Min. 0.25-inch DensDeck Prime	Polyset BOARD-MAX	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-WBA, Polyset CRA-SPATTER	-105.0

**TABLE 3c: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach	Base Ply	Cap Ply	
C-97.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min 1.5 in. thick, max. 4 x 4 ft IB EnergyBoard II, ACFoam II or Multi-Max FA3	Note 2	1 per 3.2 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG-EF-ECO or Polyset CRA-SPATTER	-30.0

**TABLE 3c: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck <a href="#">(Note 1)</a>	Base Insulation <a href="#">(Note 3, Note 13)</a>	Top Insulation Layer			Roof Cover <a href="#">(Note 15)</a>		<a href="#">MDP (psf)</a>
			Type	Fasteners <a href="#">(Note 11)</a>	Attach	Base Ply	Cap Ply	
C-98.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG	Note 2	1 per 2.0 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG-EF-ECO or Polyset CRA-SPATTER	-45.0
C-99.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min 2 in. thick, max. 4 x 4 ft IB EnergyBoard II, ACFoam II or Multi-Max FA3	Note 2	1 per 4.0 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG-EF-ECO or Polyset CRA-SPATTER	-45.0
C-100.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield, H-Shield CG, Insulfoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	✓ None	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-75.0
C-101.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch DensDeck Prime	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS	-75.0
C-102.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	✓ None	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-75.0

**TABLE 3c: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach	Base Ply	Cap Ply	
C-103.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB Heavy Duty Fastener with IB Insulation Plates, #14 Roofgrip, OMG Heavy Duty, OMG CD-10 or OMG Fluted Nail with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft <sup>2</sup>	✓ Polyglass “Elastoflex S6” or “Elastoflex V”, torch-applied ✓ US Ply “DuraFlex 60TG SBS Base” or “DuraFlex 90TG SBS Base, torch-applied	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-LPS ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / Polyset CRA-SPATTER	-75.0

**TABLE 3d: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 3, Note 13)	Attachment		Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Density		
C-104.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 6 ft <sup>2</sup> 2x3-ft grid, staggered	“IB PVC Single Ply” induction welded with SFS <i>isoweld</i> ® 3000 tool.	-37.5
C-105.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	12-inch o.c. in rows 60-inch o.c.	“IB PVC” or “IB PVC Single Ply” induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
C-106.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 6 ft <sup>2</sup> 2x3-ft grid, staggered	“IB PVC” induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
C-107.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 4.0 ft <sup>2</sup> 2x2-ft grid, staggered	“IB PVC Single Ply” induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
C-108.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 3.0 ft <sup>2</sup> 1.5 x 2-ft grid, staggered	“IB PVC” or “IB PVC Single Ply” induction welded with SFS <i>isoweld</i> ® 3000 tool.	-82.5
C-109.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	6-inch o.c. in rows 60-inch o.c.	“IB PVC” or “IB PVC Single Ply” induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0

**TABLE 3E: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER**  
**SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Insulation (Note 3, Note 13)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attach	
C-110.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 18-inch x 67-inch	-30.0
C-111.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 12-inch x 67-inch	-45.0
C-112.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 6-inch x 67-inch	-60.0
C-113.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 6-inch x 67-inch	-67.5
C-114.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	"IB PVC Single Ply"	OMG CD-10 Fasteners through OMG Polymer Batten Strips	In-Field: 6-inch x 96-inch	-67.5
C-115.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	"IB PVC Single Ply"	OMG CD-10 Fasteners through OMG Metal Batten Strips	In-Field: 6-inch x 96-inch	-75.0
C-116.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	"IB PVC" or "IB PVC Single Ply"	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 6-inch x 31-inch	-127.5

**TABLE 3F: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
**SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

System No.	Deck (Note 1)	Roof Cover (Note 15)	MDP (psf)
C-117.	Min. 2,500 psi structural concrete	✓ "IB PVC" or "IB PVC Single Ply" / IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-WBA-636, M-PG1-LPS or M-PG1-EF-ECO	-327.5
C-118.	Min. 2,500 psi structural concrete	✓ "IB PVC" or "IB PVC Single Ply" / IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-WBA, Polyset CRA-SPATTER	-512.5

**TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Lightweight Concrete ( <a href="#">Note 14</a> )	Base Insulation Layer		Coverboard		Roof Cover ( <a href="#">Note 15</a> )	<a href="#">MDP</a> (psf)
			Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
CELCORE (FL2037):								
LWC-1	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-180.0
LWC-2	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-180.0
LWC-3	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-202.5
LWC-4	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-202.5
LWC-5	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5” EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layers base insulation	Polyset CRA	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
LWC-6	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	(Optional) Min. 1.5” EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-222.5
LWC-7	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	(Optional) Min. 1.5” EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-222.5
ELASTIZELL (FL4994):								
LWC-8	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5” EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layers base insulation	Polyset CRA	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-180.0

**TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck <a href="#">(Note 1)</a>	Lightweight Concrete <a href="#">(Note 14)</a>	Base Insulation Layer		Coverboard		Roof Cover <a href="#">(Note 15)</a>	<a href="#">MDP (psf)</a>
			Type	Attach <a href="#">(Notes 6,7,8)</a>	Type	Attach <a href="#">(Notes 6,7,8)</a>		
LWC-9	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-180.0
LWC-10	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-180.0
LWC-11	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-180.0
LWC-12	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-180.0
LWC-13	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-202.5
LWC-14	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-202.5
LWC-15	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5" EnergyBoard II, AC Foam II	OB500	(Optional) Additional layers base insulation	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
LWC-16	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5" EnergyBoard II, AC Foam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-225.0

**TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> )	Lightweight Concrete ( <a href="#">Note 14</a> )	Base Insulation Layer		Coverboard		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf)
			Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
LWC-17	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5" EnergyBoard II, AC Foam II	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-225.0
<b>MEARLCRETE (FL13492):</b>								
LWC-18	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-180.0
LWC-19	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-180.0
LWC-20	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-202.5
LWC-21	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-202.5
LWC-22	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layers base insulation	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
LWC-23	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-240.0
LWC-24	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-240.0

**TABLE 4B: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)**
**SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

System No.	Deck <a href="#">(Note 1)</a>	Lightweight Concrete <a href="#">(Note 14)</a>	Treatment	Roof Cover <a href="#">(Note 15)</a>	<a href="#">MDP</a> <a href="#">(psf)</a>
<b>CELCORE (FL2037):</b>					
LWC-25	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete	In accordance with LWIC manufacturer's requirements	✓ "IB PVC" or "IB PVC Single Ply" / IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-242.5
<b>ELASTIZELL (FL4994):</b>					
LWC-26	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	In accordance with LWIC manufacturer's requirements	✓ "IB PVC" or "IB PVC Single Ply" / IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-242.5
<b>MEARLCRETE (FL13492):</b>					
LWC-27	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	In accordance with LWIC manufacturer's requirements	✓ "IB PVC" or "IB PVC Single Ply" / IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-242.5

**TABLE 5A: CEMENTITIOUS WOOD FIBER DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf)
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
CWF-1.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	OB500	(Optional) Additional layer(s) of base insulation	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, <b>M-PG1-LPS, M-PG1-EF-ECO</b> or Polyset CRA-SPATTER	-45.0
CWF-2.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-45.0
CWF-3.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-45.0
CWF-4.	Existing Tectum Plank or Tectum LS Plank or Fibroplank (re-roof only)	Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layer(s) of base insulation	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-52.5
CWF-5.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-52.5
CWF-6.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	(Optional) Min. 1.5" EnergyBoard II, AC Foam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-52.5
CWF-7.	Tectum Plank	(Optional if Coverboard installed) One or more layer(s), min. 1-inch EnergyBoard II, AC Foam-II, EnergyBoard III, AC Foam III, GAF EnergyGuard Polyiso Insulation, ENRGY 3, H-Shield or Multi-Max FA3	Polyset BOARD-MAX	Min. 0.25-inch DensDeck Prime	Polyset BOARD-MAX	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-WBA ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-WBA, M-PG1-LPS or Polyset CRA-SPATTER	-75.0

**TABLE 6A: GYPSUM DECKS - REROOF (TEAR-OFF)**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	<a href="#">MDP</a> (psf)
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
INSULATION IN IB RAPID SET INSULATION ADHESIVE, MILLENNIUM ONE STEP FOAMABLE ADHESIVE OR MILLENNIUM PG-1 PUMP GRADE ADHESIVE:							
G-1.	Existing poured gypsum or gypsum plank	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	(Optional) Additional layers(s) of base insulation	IB-RSIA, M-OSFA, M-PG1	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-202.5
G-2.	Existing poured gypsum or gypsum plank	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-202.5
G-3.	Existing poured gypsum or gypsum plank	Min. 1.5-inch EnergyBoard II, AC Foam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-202.5
INSULATION IN OLYBOND 500:							
G-4.	Existing poured gypsum or gypsum plank	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-52.5
G-5.	Existing poured gypsum or gypsum plank	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-52.5
G-6.	Existing poured gypsum or gypsum plank	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-112.5
G-7.	Existing poured gypsum or gypsum plank	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-112.5
G-8.	Existing poured gypsum or gypsum plank	Min. 1.5-inch EnergyBoard II, AC Foam II	OB500	(Optional) Additional layers(s) of base insulation	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-112.5

**TABLE 6A: GYPSUM DECKS - REROOF (TEAR-OFF)**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf)
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
G-9.	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-112.5
G-10.	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-112.5
<b>INSULATION IN ICP ADHESIVES POLYSET CRA:</b>							
G-11.	Existing poured gypsum or gypsum plank	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-180.0
G-12.	Existing poured gypsum or gypsum plank	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-180.0
G-13.	Existing poured gypsum or gypsum plank	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) of base insulation	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
G-14.	Existing poured gypsum or gypsum plank	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-245.0
G-15.	Existing poured gypsum or gypsum plank	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-245.0
<b>INSULATION IN ICP ADHESIVES POLYSET BOARD-MAX:</b>							

**TABLE 6A: GYPSUM DECKS - REROOF (TEAR-OFF)**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	<a href="#">MDP (psf)</a>
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
G-16.	Existing poured gypsum or gypsum plank	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield	Polysat BOARD-MAX	(Optional) Additional layers(s) of base insulation	Polysat BOARD-MAX	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polysat CRA-SPATTER	-215.0
G-17.	Existing poured gypsum or gypsum plank	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, Multi-Max FA3	Polysat BOARD-MAX	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polysat BOARD-MAX	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polysat CRA-SPATTER	-245.0
G-18.	Existing poured gypsum or gypsum plank	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, Multi-Max FA3	Polysat BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polysat BOARD-MAX	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-245.0

**TABLE 7A: RECOVER APPLICATIONS**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

<sup>A</sup> The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	<a href="#">MDP (psf)</a> <sup>A</sup>
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
INSULATION IN HOT ASPHALT:							
R-1.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch Insulfoam IX	HA (back-mopped)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA (back-mopped)	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-202.5
R-2.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch Insulfoam IX	HA (back-mopped)	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	HA (back-mopped)	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-202.5
R-3.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	HA	(Optional) Additional layers(s) of base insulation	HA	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
R-4.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	HA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-255.0
R-5.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	HA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	HA	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-255.0
INSULATION IN IB RAPID SET INSULATION ADHESIVE, MILLENNIUM ONE STEP FOAMABLE ADHESIVE OR MILLENNIUM PG-1 PUMP GRADE ADHESIVE:							
R-6.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	(Optional) Additional layers(s) of base insulation	IB-RSIA, M-OSFA, M-PG1	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
R-7.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-232.5
R-8.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	IB-RSIA, M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	IB-RSIA, M-OSFA, M-PG1	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-232.5

**TABLE 7A: RECOVER APPLICATIONS**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

<sup>A</sup> The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf) <sup>A</sup>
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
INSULATION IN MILLENNIUM PG-1 EF ECO ADHESIVE:							
R-9.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	M-PG1-EF-ECO	(Optional) Additional layers(s) of base insulation	M-PG1-EF-ECO	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-215.0
R-10.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-232.5
R-11.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, ACFoam II or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-232.5
INSULATION IN OLYBOND 500:							
R-12.	Existing asphaltic BUR or modified bitumen	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-52.5
R-13.	Existing asphaltic BUR or modified bitumen	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-52.5
R-14.	Existing asphaltic BUR or modified bitumen	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ “IB PVC” or “IB PVC Single Ply” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-120.0
R-15.	Existing asphaltic BUR or modified bitumen	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ “IB PVC Fleeceback” or “IB PVC Single Ply Fleeceback” / M-PG1-EF-ECO	-120.0

**TABLE 7A: RECOVER APPLICATIONS**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

<sup>A</sup> The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf) <sup>A</sup>
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
R-16.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch EnergyBoard II, AC Foam II	OB500	(Optional) Additional layer(s) of base insulation	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-120.0
R-17.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, AC Foam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-120.0
R-18.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch EnergyBoard II, AC Foam II	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-120.0
<b>INSULATION IN ICP ADHESIVES POLYSET CRA:</b>							
R-19.	Existing smooth-surface asphaltic BUR or smooth- or granule-surface modified bitumen	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-180.0
R-20.	Existing smooth-surface asphaltic BUR or smooth- or granule-surface modified bitumen	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS or M-PG1-EF-ECO	-180.0
R-21.	Existing smooth-surface modified bitumen	Min. 1-inch Multi-Max FA3, UltraMax	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-222.5
R-22.	Existing smooth-surface modified bitumen	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-222.5
R-23.	Existing smooth-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, AC Foam II, AC Foam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-222.5

**TABLE 7A: RECOVER APPLICATIONS**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

<sup>A</sup> The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf) <sup>A</sup>
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
R-24.	Existing smooth-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-222.5
R-25.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	Min. 1-inch Multi-Max FA3, UltraMax	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-250.0
R-26.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime	Polyset CRA	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636	-257.5
R-27.	Existing smooth-surface asphaltic BUR	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-262.5
R-28.	Existing smooth-surface asphaltic BUR	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636	-262.5
R-29.	Existing smooth-surface asphaltic BUR	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS or Polyset CRA-SPATTER	-262.5
R-30.	Existing smooth-surface asphaltic BUR	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-262.5

**TABLE 7A: RECOVER APPLICATIONS**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

<sup>A</sup> The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf) <sup>A</sup>
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
R-31.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636	-267.5
R-32.	Existing granule-surface modified bitumen	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-270.0
R-33.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS or Polyset CRA-SPATTER	-270.0
R-34.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-EF-ECO	-270.0
<b>INSULATION IN ICP ADHESIVES POLYSET BOARD-MAX:</b>							
R-35.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, Polyset CRA-SPATTER	-180.0
R-36.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS or M-PG1-EF-ECO	-180.0
R-37.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	Min. 1-inch Multi-Max FA3, UltraMax	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-250.0

**TABLE 7A: RECOVER APPLICATIONS**  
**SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

<sup>A</sup> The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Base Insulation Layer		Top Insulation Layer		Roof Cover ( <a href="#">Note 15</a> )	MDP (psf) <sup>A</sup>
		Type	Attach ( <a href="#">Notes 6,7,8</a> )	Type	Attach ( <a href="#">Notes 6,7,8</a> )		
R-38.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.5-inch DensDeck Prime	Polyset BOARD-MAX	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS or Polyset CRA-SPATTER	-232.5
R-39.	Existing smooth-surface asphaltic BUR	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-262.5
R-40.	Existing smooth-surface asphaltic BUR	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-262.5
R-41.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636	-267.5
R-42.	Existing granule-surface modified bitumen	Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ "IB PVC" or "IB PVC Single Ply" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636 ✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / IB-Vertibond, IB-Vertibond-432, IB-WBA, IB-WBA-636, M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-270.0
R-43.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch IB EnergyBoard II, IB EnergyBoard III, ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ "IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback" / M-PG1-LPS, M-PG1-EF-ECO or Polyset CRA-SPATTER	-270.0

**TABLE 7b: STEEL - RECOVER**
**SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER**
*(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)*

System No.	Substrate (Note 1)	Insulation Layer	Attachment		Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Spacing		
R-44.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 60-inch o.c.</b>	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	12-inch o.c. along purlins	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
R-45.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 48-inch o.c.</b>	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	12-inch o.c. along purlins	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-67.5
R-46.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 60-inch o.c.</b>	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	6-inch o.c. along purlins	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0
R-47.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 48-inch o.c.</b>	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	9-inch o.c. along purlins	"IB PVC" or "IB PVC Single Ply" induction welded with SFS <i>isoweld</i> ® 3000 tool.	-97.5

**TABLE 7c: STEEL – RECOVER**
**SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER**
*(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)*

System No.	Substrate (Note 1)	Insulation	Roof Cover			MDP (psf)
			Membrane	Fasteners (Note 11)	Attach	
R-48.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 60-inch o.c.</b>	One or more layers, any combination, preliminarily attached (Note 5)	"IB PVC" or "IB PVC Single Ply"	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 18-inch x 60-inch	-30.0
R-49.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 60-inch o.c.</b>	One or more layers, any combination, preliminarily attached (Note 5)	"IB PVC" or "IB PVC Single Ply"	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 12-inch x 60-inch	-45.0
R-50.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 60-inch o.c.</b>	One or more layers, any combination, preliminarily attached (Note 5)	"IB PVC" or "IB PVC Single Ply"	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 6-inch x 60-inch	-67.5
R-51.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced <b>max. 30-inch o.c.</b>	One or more layers, any combination, preliminarily attached (Note 5)	"IB PVC" or "IB PVC Single Ply"	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 6-inch x 30-inch	-127.5

**TABLE 7D: RECOVER APPLICATIONS**  
**SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

<sup>A</sup> The reported MDP documents the allowable maximum design pressure of the new roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate ( <a href="#">Note 1</a> , <a href="#">Note 12</a> )	Roof Cover ( <a href="#">Note 15</a> )		MDP (psf) <sup>A</sup>
		Type	Attach	
R-52.	Existing fully adhered, smooth-surface asphalt built-up or smooth-surface APP modified bitumen roof or granule-surface asphalt-built-up or granule-surface APP or SBS modified bitumen roof	"IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback"	M-PG1, 12-inch o.c.	-67.5
R-53.	Existing fully adhered, smooth-surface APP modified bitumen roof	"IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback"	Polyset CRA-SPATTER	-75.0
R-54.	Existing fully adhered, smooth-surface asphalt built-up or smooth-surface APP modified bitumen roof or granule-surface asphalt-built-up or granule-surface APP or SBS modified bitumen roof	"IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback"	M-PG1, 6-inch o.c.	-112.5
R-55.	Existing mechanically fastened base sheet with fully adhered, granule-surface asphalt-built-up or granule-surface APP or SBS modified bitumen roof	"IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback"	M-PG1, 6-inch o.c. or Polyset CRA-SPATTER	-112.5
R-56.	Existing fully adhered, smooth-surface, asphalt built-up roof	"IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback"	Polyset CRA-SPATTER	-222.5
R-57.	Existing fully adhered, granule-surface SBS or APP modified bitumen roof	"IB PVC Fleeceback" or "IB PVC Single Ply Fleeceback"	Polyset CRA-SPATTER	-250.0